


PLAN
NTS

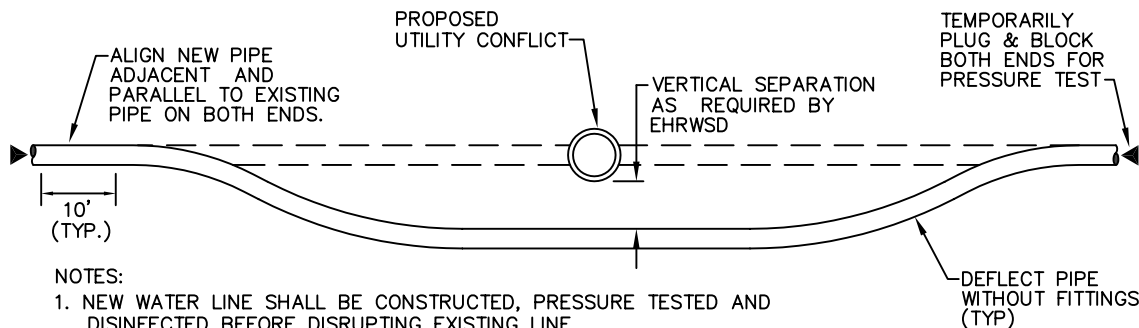

NOTES:

1. NEW WATER LINE SHALL BE CONSTRUCTED, PRESSURE TESTED AND DISINFECTED BEFORE DISRUPTING EXISTING LINE.
2. CONTRACTOR SHALL PERFORM PRESSURE TEST AND DISINFECTION PER EHRWSD SPECIFICATIONS.
3. EHRWSD WILL FLUSH LINE AND PROVIDE BACTERIOLOGICAL TESTING.
4. UPON ACCEPTANCE OF NEW LINE, EHRWSD WILL CONNECT TO EXISTING LINE AT EACH END.

Earnhart Hill Regional
Water and Sewer District

2030 Stoneridge Dr.
P.O Box 151
Circleville, OH 43113

WATER LINE RELOCATION - DIRECTIONAL BORING

Revised
04-25-07

Scale
None

Page 1 of 1

Drawing : D-6