



MAIN LINE	DIMENSION L	
	TYPE B	TYPE B MOD.
6"	24"	19"
8"	25"	20"
12"	28"	23"
16"	31"	26"

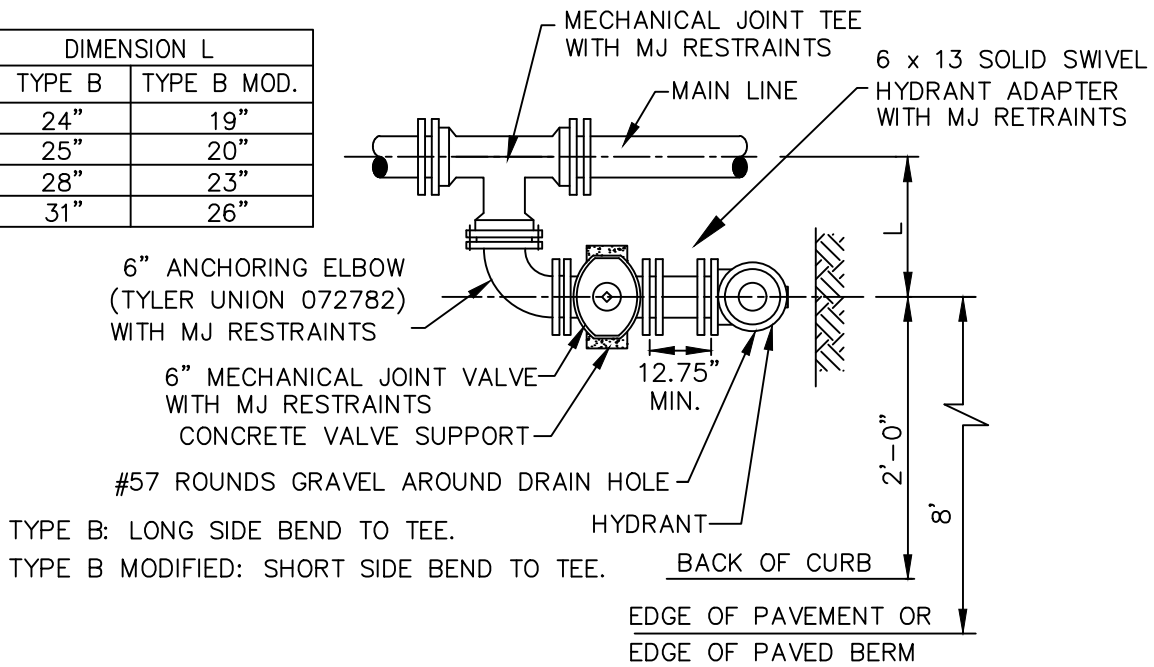

NOTES:

1. FIRE HYDRANTS SHALL BE SET A MINIMUM OF 6' FROM ALL DRIVEWAY OPENINGS AND 2' FROM CURBS.
2. FIRE HYDRANTS SHALL BE FACTORY PAINTED YELLOW OR RED AS NOTED IN PLANS.
3. REFER TO TRACER WIRE DETAIL.

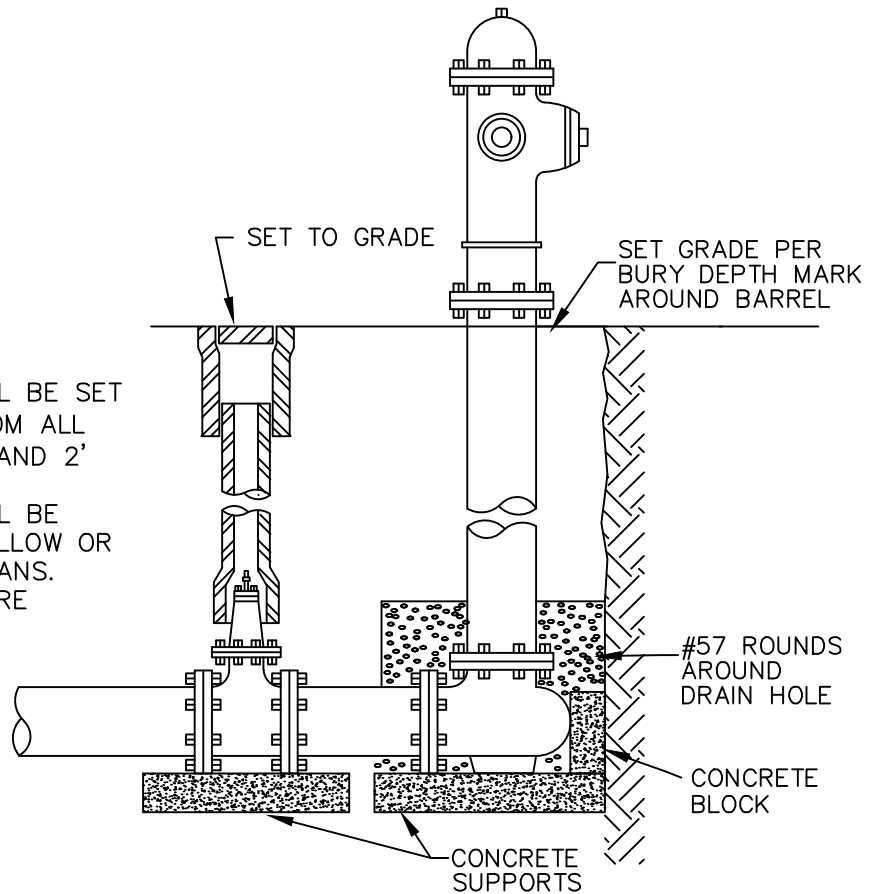

HYDRANT SETTING TYPE B